


TOP OF EIA
MOUNTING SURFACE

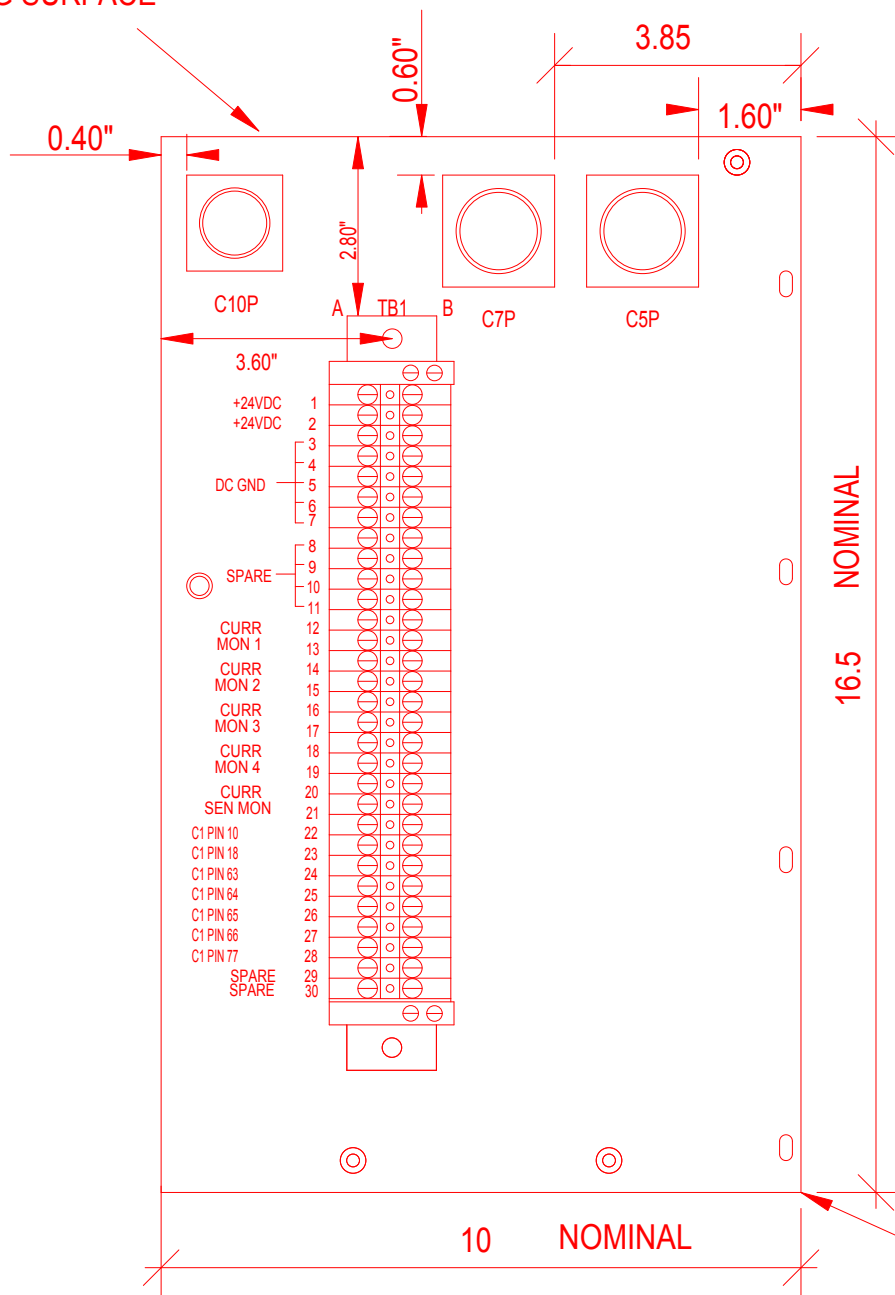

NOTES:

1. Provide and install a 30 position TB1 Terminal Block and three circular connectors, C5P, C7P and C10P (no contracts). TB1 shall be a USK 10 Open Construction Phoenix Contact Terminal Block (or equal) mounted on DIN Railing (supported every 6 inches) with position function label tabs and positions commoned and end locks.
2. A 4 foot length "CMS" Harness of 14 #20 (or larger) Conductors shall be furnished and installed in the cabinet. One end of the harness shall be the C10S Connector resting in C10P (mounted on the Input Panel #3) when not in use. The other end shall be stripped (according to manufacturers requirements) and connected to the "B Side" of TB1. The conductor bundle shall have external protection.

Panel continuous
or two sections
(upper and lower)

Title:		
MODEL 334C CABINET, INPUT FILE NO. 3		
DETAIL - UPPER PART		
Date:	JULY 1996	Page: 8-7-8